




INSTALLATION INSTRUCTIONS

CAT No. EIU

Moulded cable gland for metalclad consumer units fitted with RCD main switch
To provide additional support and insulation for the incoming cables.
Suitable for 16mm² or 25mm² double insulated, sleeved cables.

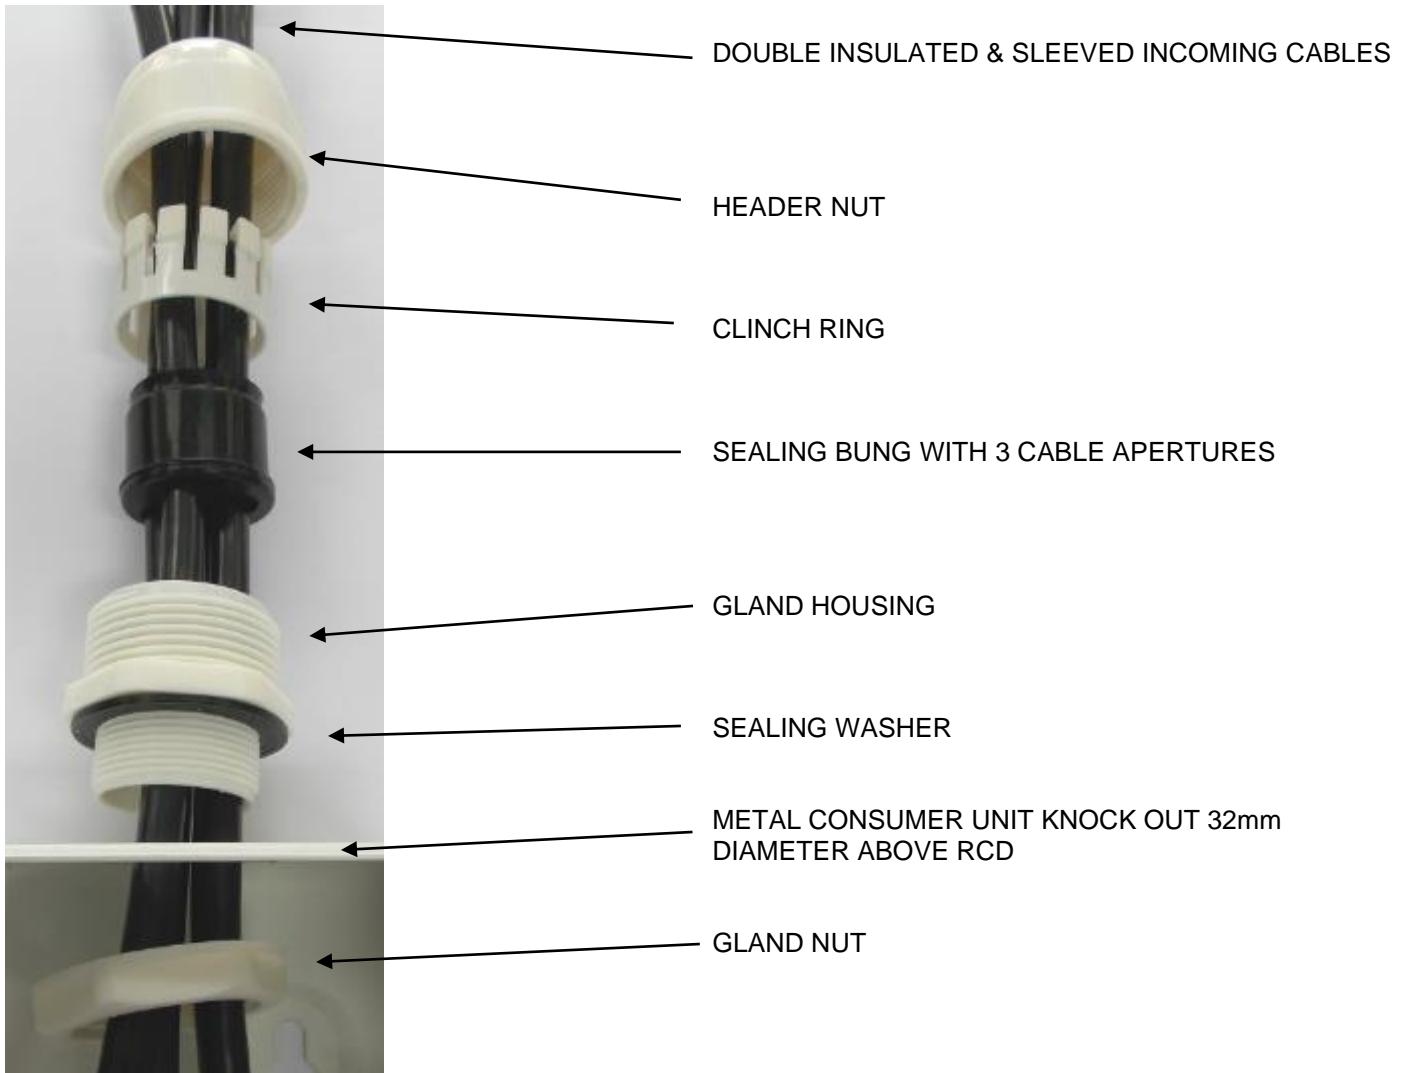

The kit comprises a 32mm insulated cable restraining gland, which is fitted by removing the knockout above the incoming terminals and fixing into position with the nut included. The incoming supply cables must be passed through the 3 aperture sealing bung.

The sequence of assembly over cables is as shown above. Tighten the gland and header nut when installation of incoming cables is complete.

If the incoming supply cables are to be protected by conduit this must be of the all insulated type.



Electrium Sales Limited, Walkmill Lane, Cannock,
WS11 0XE, England Tel: 01543 455000

Fax: 01543 455001

Waste electrical products should not be disposed of with household waste.
Please recycle where waste disposal facilities exist.
Check with your retailer, wholesaler or local authority for recycling advice.

