





INSTALLATION INSTRUCTIONS

2 Module Slimline Enclosure (Regional Electricity Company Enclosure)

CABLE STRIPPING DETAILS

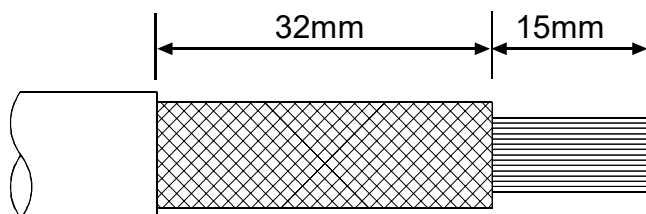

Double Insulated (25mm²)

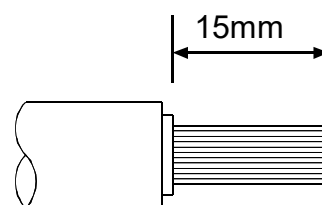

Double Insulated (16mm²)

Use No.2 Pozi-drive bit


Recommended tightening torque	Main switch	Max cable Capacity 50mm ²	2.3Nm / (20 lbf-in)
-------------------------------	-------------	--------------------------------------	---------------------

DO NOT connect using power driven screwdrivers

LARGE COVER TO BE FITTED OVER INCOMING TERMINALS


SECURITY SEALING OF FRONT COVER - either:

a)

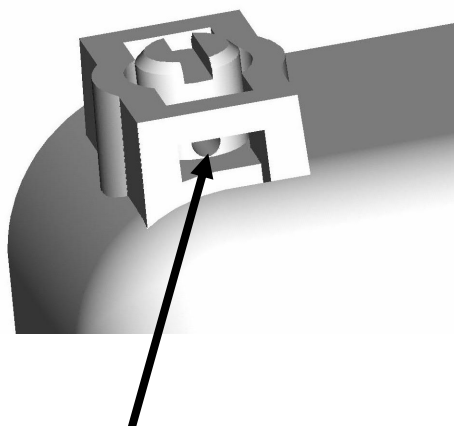

Insert wire or plastic seal through tamper-proof screw.

b)

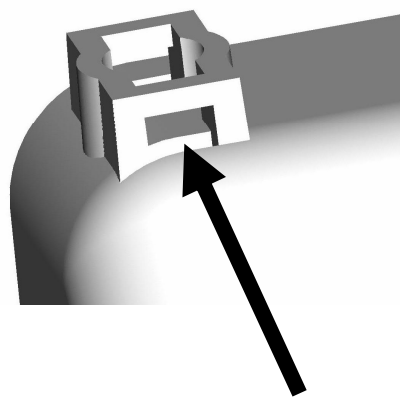

Insert flat plastic seal into cover above head of standard screw.


SEALS SPECIFIED & PROVISIONED BY REGIONAL ELECTRICITY COMPANY




INSTALLATION INSTRUCTIONS

2 Module Slimline Enclosure (Regional Electricity Company Enclosure)

CABLE STRIPPING DETAILS

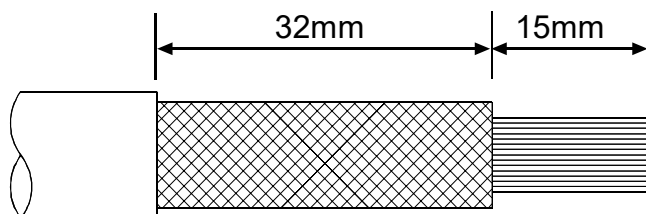

Double Insulated (25mm²)

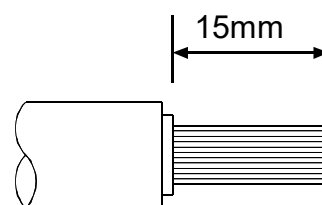

Double Insulated (16mm²)

Use No.2 Pozi-drive bit


Recommended tightening torque	Main switch	Max cable Capacity 50mm ²	2.3Nm / (20 lbf-in)
-------------------------------	-------------	--------------------------------------	---------------------

DO NOT connect using power driven screwdrivers

LARGE COVER TO BE FITTED OVER INCOMING TERMINALS


SECURITY SEALING OF FRONT COVER - either:

a)

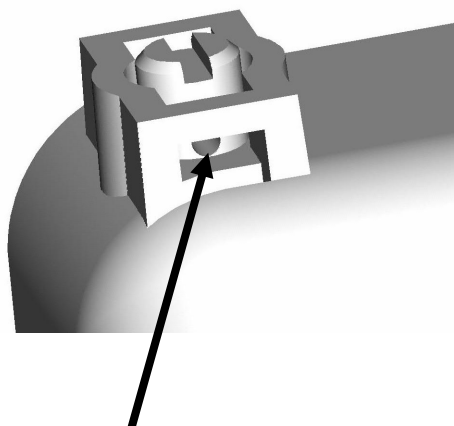

Insert wire or plastic seal through tamper-proof screw.

b)

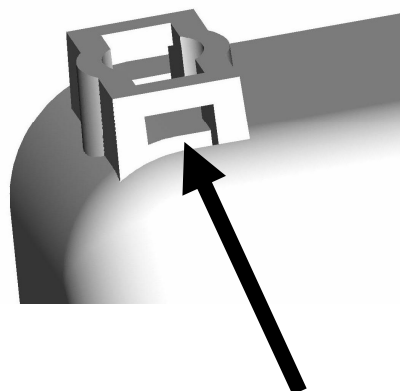

Insert flat plastic seal into cover above head of standard screw.

SEALS SPECIFIED & PROVISIONED BY REGIONAL ELECTRICITY COMPANY